

TICA Central Air Conditioner Water-cooled Flooded Screw Chiller (Heat Pump)

Established in 1991

TICA is a professional enterprise specialized in R&D, manufacturing, sales and services of environment cleaning and thermal energy utilization.

TICA is a national high-tech enterprise, a single leading enterprise cultivated by the Ministry of Industry and Information Technology, a national brand cultivation enterprise of the Ministry of Industry and Information Technology, and a vice chairman member of China Refrigeration and Air-conditioning Industry Association. It has a national-recognized enterprise technology center, an enterprise academician workstation, and a post-doctoral research workstation. Its projects cover Beijing Bird's Nest Stadium, Water Cube, Wukesong Indoor Stadium, PetroChina, Sinopec, State Grid, Nanjing Panda, Hangzhou Xiaoshan International Airport, Hainan Airlines Group, Shangri-La Hotel, Manila Ocean Park, Abu Dhabi Al Muneera, SM City in Philippines and Unilever, etc.

TICA is also the outstanding provider of central air conditioners for China's subway networks and has successfully served nearly 60 key subway lines in major cities such as Beijing, Shanghai, Guangzhou, Shenzhen, Chengdu, Suzhou, Hangzhou and Tianjin. TICA is a professional supplier and service provider in China that specializes in system integration of clean environment. While for microelectronics, hospital operating rooms, biopharmaceutical industry and other professional purification areas, our market share has achieved over 40% in each.

TICA Quality For IAQ

TICA focuses on indoor air quality (IAQ) in clean environments. Product lines include return air purifiers, heat recovery ventilators, fresh air purifiers, air purifiers, as well as the clean air handling units and digital variable-capacity air handling units used in the professional purification field. Regarding core technology, TICA established an ISO class 1 super-clean environment integration system and won the first prize of CMIST.

TICA's product lines include modular chillers, VRF units, screw chillers, centrifugal chillers, and ORC low-temperature waste heat power generation systems. In 2015, TICA and United Technologies Corporation (UTC) established a global strategic joint venture cooperation relationship and acquired PureCycle, an ORC low-temperature power generation company owned by Pratt & Whitney under UTC. TICA obtained PureCycle trademarks and more than 100 patents and national copyrights. TICA's efficient centrifugal chillers, water-cooled screw chillers, and air-cooled screw chillers are manufactured with the technical license of Carrier under UTC.

TICA is characterized by excellent system integration capability. In the application of "Efficient Refrigeration System of Underground Railway Station", the integrated COP of the refrigeration room amounts to 6.0, and the research achievement reaches the international advanced level. In 2018, TICA merged and acquired an OFC central air conditioning enterprise **SMARDT**. TICA's excellent system integration capability and the **SMARDT** OFC water chillers help increase the integrated COP of the efficient equipment room to 6.7 to 7.0.

TICA---We're striving.

TICA aims to build itself into a world-leading system integration supplier and service provider that specializes in clean environment and thermal energy utilization.



Water-cooled Flooded Screw Chiller (Heat Pump)

CONTENTS

| | |
|---|----|
| Overview | 2 |
| Features | 3 |
| Specifications | 6 |
| Technical Parameter Correction Factor Diagram | 13 |
| Customizable Component | 18 |
| Unit Dimensions | 21 |
| Lifting Diagram | 24 |
| Installation and Maintenance | 26 |
| Selection of Water System Parts | 30 |
| Check Items before Startup | 31 |
| Routine Maintenance | 33 |

TICA owns five production sites in Nanjing, Tianjin, Guangzhou, Chengdu and Kuala Lumpur, and a network of over 70 sales and service outlets around the world.

Its Nanjing HQ base received 3-star certification for national No. 001 green industrial construction.




Nanjing Headquarters



Tianjin Base



Guangzhou Base

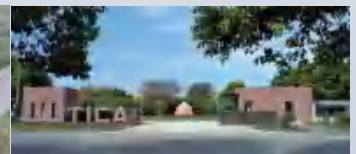


Chengdu Base



TICA water-cooled flooded screw chiller adopts a compact design and is equipped with the flooded evaporator, semi-hermetic double-screw compressor and high efficient heat exchanger. Together with the advanced microcomputer control technology, the chiller is highly stable and reliable, and features efficient and quiet operations. Available in a variety of models, the units are ideal for scenarios requiring comfort and process cooling.

TICA water source heat pump units use underground water, surface water, sewage, sea water, and soil as cold and heat sources, and provide cooling in summer and heating in winter. The operating conditions are stable throughout the year, and the cooling and heating capacities can be better developed; without the needs for any cooling towers, there is minimized impact on the surroundings and the operating costs are greatly reduced.

Nomenclature

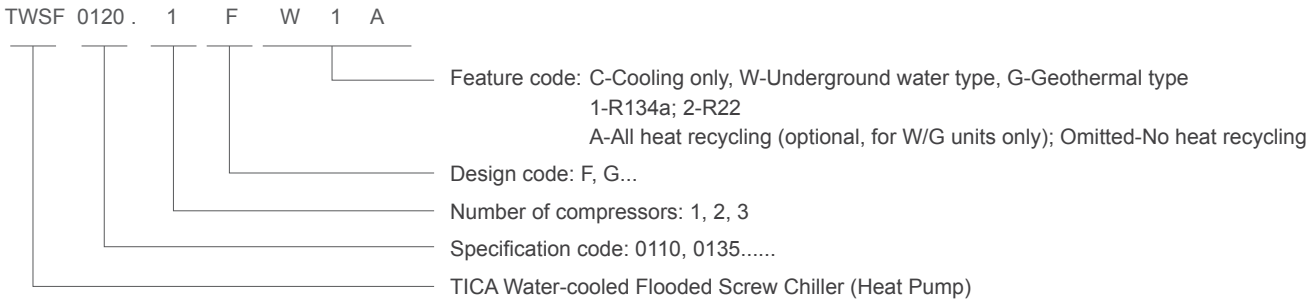

Water-cooled Flooded Screw Chiller (Heat Pump)

Features



1. Internationally Recognized Quality

The units have passed the certification of the Air-Conditioning, Heating and Refrigeration Institute (AHRI) and China Refrigeration and Air-Conditioning Industry Association (CRAA).

The units are up to the AHRI551/991-2011 standard (AHRI is considered to be the most prestigious organization in the international refrigeration industry).

Both TICA unit performance test bench and independently developed unit selection software have passed the AHRI certification. Every unit has to pass the test on the test bench recognized by AHRI before delivery.

TICA laboratory has obtained national CNAS certification.

2. High Efficiency & Energy Saving

TICA's water-cooled flooded screw chillers have all met National EEI level 2, some of which have met National EEI level 1.

- ◆ German patented, semi-hermetic double-screw compressor enables the unit to operate efficiently in both full-load and partial-load conditions.
- ◆ Evaporator and condenser equipped with enhanced heat exchange tubes improve the heat transfer efficiency and reduce the power consumption.
- ◆ TICA's unique dynamic optimization and control algorithms allow the unit to operate efficiently under different operating conditions.

3. Advanced Technology

Efficient German compressor

- ◆ The double-screw compressor special for German patented water-cooled unit boasts high adiabatic efficiency. The high-efficiency and large-capacity motor helps significantly reduce power consumption of the unit, enabling the unit to operate efficiently in full load or partial load.
- ◆ The three-stage oil separator of the compressor works with efficiency up to 99.5%.
- ◆ With the stepless regulation of the slide valve, a single compressor can match 25%–100% load change, and a dual head unit can implement 12.5%–100% load change.
- ◆ The screw rotor is processed with patented technology, and its micron-level precision ensures precise engagement and long service life.
- ◆ The compressor motor cools down by air suction to ensure long service life, and the complete protection function guarantees safe operation of the unit.
- ◆ Super high-efficiency series are equipped with GB19577 standard compressor to ensure that their energy efficiency reaches national EEI level 1; the units also use efficient motor specially tailored to China's power supply conditions, to ensure that the compressor operates efficiently for both full-load and partial-load conditions; Bizter smart module control technology allows monitoring the units in real time, including their voltage, temperature, pressure and operating condition, to ensure reliable operation.




Energy Efficiency Label



Authentication certificate of energy saving products



Energy saving test report

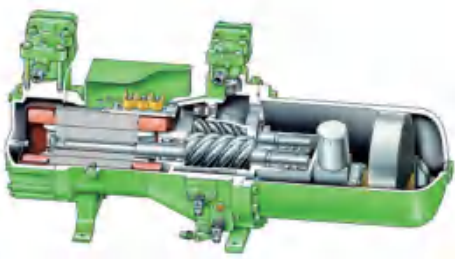


Brand new high-efficiency heat exchanger

- ◆ The shell-and-tube type, flooded evaporator features newly arranged and enhanced bilateral heat exchange tubes to guarantee efficient heat exchange; uses CFD simulation to calculate and design liquid baffle to balance the air field, ensuring liquid level stability, and absorbing air only instead of liquid and guaranteeing stable operation.
- ◆ The shell-and-tube type condenser features built-in TICA's patented oil separator, allowing the oil separation efficiency to be up to 99.9% combined with the compressor embedded oil separator; uses CFD simulation to calculate and analyze sub-cooling part, and increases the refrigerant's supercooling degree by 2-3 times, ensuring that liquid supply pipes are free of gaseous refrigerant and the unit operates efficiently and reliably.
- ◆ The detachable lid makes it easy to cleanse the inside of heat exchange tubes, thereby ensuring high efficiency of heat exchanging.



Sophisticated throttle apparatus and unique oil return

- ◆ The sophisticated EXV features accurate control, fast speed of response, and a wide range of regulation, allowing the unit to operate reliably whether under full load or partial load.
- ◆ The continuous oil return technology – oil injected by oil – adopts the cutting-edge, special injection pump to inject the remaining 0.1% oil in the evaporator into the compressor to ensure safe and reliable running of the compressor.
- ◆ With TICA's patented technology of automatic oil injection, the system will automatically start oil-injection control program when the oil level in the compressor reaches the low limit, ensuring the compressor's safe and efficient operation.


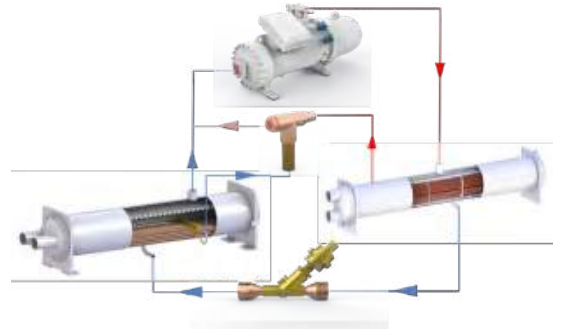


Compact and easy to install

- ◆ Both the evaporator and condenser are configured with flanges and clamps to make field installation convenient.
- ◆ The unit requires a small floor area due to the compact structure.
- ◆ The refrigerant water flow ranges from 40% to 110% of the nominal flow, making it more suitable for flow variable primary pump.
- ◆ The unit is configured with a compressor startup cabinet, to facilitate on-site cable connection by the user.
- ◆ The unit is properly insulated.
- ◆ With minimal vibration, the unit is equipped with 4 pieces of 30mm chloroprene rubber shock-absorbing cushions.
- ◆ Sufficient refrigerant has been charged in the unit before the entire unit is delivered.
- ◆ During installation on site, users only need to connect the water pipes of evaporator and condenser and connect the power supply.



4. Precise Control System and Reliable Operation

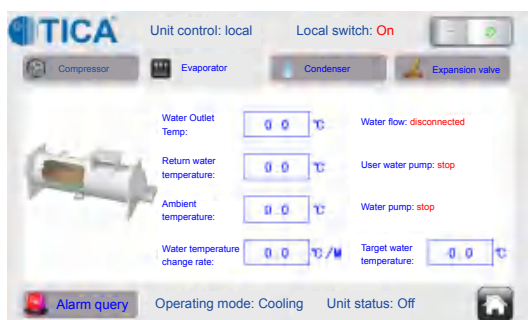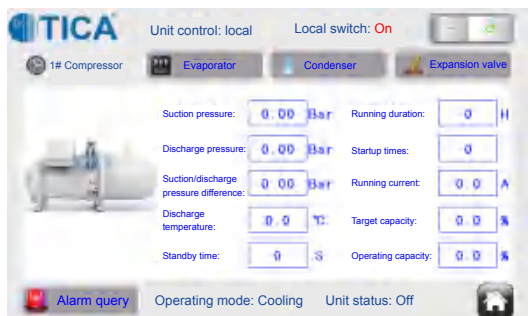

◆ Sophisticated control system

—The industrial-level microcomputer controller, together with the 7-inch colored touch screen, constitutes the control unit of the unit. As a result, the unit is rather reliable and jamproof and therefore ideal for complicated, hostile working environments.

◆ Unique dynamic optimization and control algorithms

—Benefiting from TICA's years of experience in air conditioning design and application, the control algorithms feature more precise calculation of unit load; the algorithms are integrated with TICA's unique dynamic optimization and control to allow the units to make adjustments in all operating conditions and to ensure the units are keeping running in an efficient, reliable and secure manner; The refrigerant water flow ranges from 40% to 110% of the nominal flow, making it more suitable for flow variable primary pump.

◆ Intelligent control

—The advanced pre-control function enables measures to be taken promptly before actual failure occurs to avoid unexpected shutdown of the unit due to an alarm.

—Multiple compressors can operate automatically to reach a load balance and therefore can prolong the service life of the unit.

—Each compressor and circuit can be controlled independently and can serve as the standby for another compressor, minimizing the impact of possible faults.

—Unique oil return control technology resolves the issue of oil separation.

—Benefiting from the fuzzy control technology, the unit is able to adjust the water temperature based on outdoor air temperature and hence can enhance efficiency to the greatest extent while meeting the needs.

—The unit supports the compiling of weekly operating schedules to implement comprehensive automatic start and stop control of the unit, and can truly be left unattended.

◆ Complete safety protection

—Power supply protection: phase loss, reverse phase, over-voltage, and under-voltage

—Compressor protection: protection for motor overheat, overload, frequent startup, oil level and high discharge temperature

—Pressure protection: both evaporator and condenser are equipped with safety valves, and have protection when low pressure is too low, high pressure is too high, and protection for low air suction/discharge pressure difference.

—Other protection: too low water temperature protection, too low water flow protection, sensor failure protection, etc.

◆ Flexible and convenient group communication

—Standard RS485 interface and MODBUS RTU protocol are provided, and the unit is connected to the building automation system (BAS), which implements centralized control and remote monitoring of the unit and control of other attached devices according to the controlling requirement of the BAS.

◆ Creative wireless communication technology (optional)

—The configured wireless communication module provides Ethernet connection and supports wireless short message prompt function. Users can access the unit parameters by sending short messages. The unit can automatically send short messages to the specified end-number when an alert is generated. In this way, users can access the running condition of the unit anytime anywhere.

Water-cooled Flooded Screw Chiller (Heat Pump)

Specifications

Parameters of TWSF-FC1 (R134a) flooded-type water-cooled screw chiller High-efficiency series

| Model | | TWSF-FC1 | 0110.1 | 0135.1 | 0160.1 | 0175.1 | 0200.1 | 0220.1 | 0240.1 | 0265.1 | |
|---------------------|-------------------------------|-------------------------------|--------|--------|--------|--------|--------|--------|--------|--------|--|
| Cooling capacity | Ton | | 110 | 135 | 156 | 175 | 200 | 215 | 235 | 260 | |
| | 10 ⁴ kcal/h | | 33 | 41 | 47 | 53 | 60 | 65 | 71 | 79 | |
| | kW | | 387 | 475 | 547 | 615 | 703 | 755 | 825 | 915 | |
| Power input | kW | | 65 | 80 | 91 | 102 | 116 | 125 | 136 | 151 | |
| Efficiency | kW/Ton | | 0.591 | 0.592 | 0.583 | 0.583 | 0.580 | 0.582 | 0.580 | 0.580 | |
| COP | W/W | | 5.95 | 5.94 | 6.01 | 6.03 | 6.06 | 6.04 | 6.07 | 6.06 | |
| Running current | A | | 121 | 141 | 162 | 176 | 208 | 215 | 232 | 260 | |
| Starting current | A | | 330 | 415 | 479 | 506 | 650 | 650 | 683 | 845 | |
| Compressor quantity | Set | | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | |
| Power supply | | 380 V 3N-50 Hz | | | | | | | | | |
| Refrigerant | | R134a | | | | | | | | | |
| Energy control | | Stepless regulation of energy | | | | | | | | | |
| Evaporator | Design pressure on water side | Mpa | 1.0 | | | | | | | | |
| | Water flow | m ³ /h | 67 | 82 | 94 | 106 | 121 | 130 | 142 | 157 | |
| | Water pressure drop | kPa | 74 | 72 | 73 | 72 | 73 | 74 | 75 | 86 | |
| | Piping DN | mm | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | |
| Condenser | Design pressure on water side | Mpa | 1.0 | | | | | | | | |
| | Water flow | m ³ /h | 78 | 96 | 110 | 123 | 141 | 151 | 165 | 183 | |
| | Water pressure drop | kPa | 86 | 77 | 87 | 86 | 85 | 72 | 78 | 68 | |
| | Piping DN | mm | 150 | 150 | 150 | 150 | 200 | 200 | 200 | 200 | |
| Dimensions | Length | mm | 3122 | 3122 | 3122 | 3122 | 3144 | 3144 | 3144 | 3144 | |
| | Width | mm | 1500 | 1500 | 1500 | 1500 | 1550 | 1550 | 1550 | 1550 | |
| | Height | mm | 1800 | 1800 | 1800 | 1800 | 1850 | 1850 | 1850 | 1850 | |
| Shipping weight | | kg | 2750 | 3200 | 3250 | 3350 | 3800 | 3850 | 4000 | 4150 | |
| Operating weight | | kg | 2950 | 3450 | 3490 | 3590 | 4150 | 4180 | 4400 | 4500 | |

★ Note:

1. The parameters under above operating conditions: are as follows: chilled water outlet temperature 7°C, chilled water inlet temperature 30°C.
2. For technical parameters under non-standard operating conditions, please contact branches of TICA.
3. The maximum startup current listed in the table is the current under Y-Δ startup mode.
4. Power supply: 380V 3N-50Hz; allowable voltage fluctuation: ±10%.
5. Standard water chamber pressure: 1.0 MPa; optional water chamber pressure: 1.6 MPa, 2.0 MPa.
6. Specification parameters are subject to change without prior notice, due to product improvement.



| | | | | | | | | | | | | |
|--|-------------------------------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|
| | 0280.2 | 0300.2 | 0325.2 | 0350.2 | 0370.2 | 0390.2 | 0410.2 | 0430.2 | 0450.2 | 0465.2 | 0495.2 | 0510.2 |
| | 277 | 293 | 316 | 340 | 367 | 392 | 409 | 425 | 441 | 461 | 486 | 507 |
| | 84 | 89 | 95 | 103 | 111 | 119 | 124 | 129 | 133 | 139 | 147 | 153 |
| | 973 | 1030 | 1110 | 1194 | 1292 | 1379 | 1438 | 1495 | 1551 | 1620 | 1710 | 1782 |
| | 161 | 171 | 184 | 198 | 215 | 228 | 238 | 245 | 255 | 267 | 281 | 293 |
| | 0.582 | 0.584 | 0.583 | 0.583 | 0.585 | 0.581 | 0.582 | 0.576 | 0.578 | 0.579 | 0.578 | 0.578 |
| | 6.04 | 6.02 | 6.03 | 6.03 | 6.01 | 6.05 | 6.04 | 6.10 | 6.08 | 6.07 | 6.09 | 6.08 |
| | 285 | 301 | 324 | 344 | 360 | 380 | 420 | 430 | 440 | 464 | 490 | 516 |
| | 660 | 724 | 759 | 801 | 828 | 972 | 1013 | 1013 | 1048 | 1081 | 1243 | 1278 |
| | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 |
| | 380 V 3N-50 Hz | | | | | | | | | | | |
| | R134a | | | | | | | | | | | |
| | Stepless regulation of energy | | | | | | | | | | | |
| | 1.0 | | | | | | | | | | | |
| | 167 | 177 | 191 | 205 | 222 | 237 | 247 | 257 | 267 | 279 | 294 | 307 |
| | 65 | 80 | 72 | 80 | 66 | 65 | 72 | 57 | 63 | 63 | 63 | 62 |
| | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 |
| | 1.0 | | | | | | | | | | | |
| | 195 | 207 | 223 | 240 | 259 | 276 | 288 | 300 | 311 | 325 | 343 | 357 |
| | 65 | 83 | 83 | 85 | 57 | 56 | 86 | 56 | 59 | 61 | 60 | 62 |
| | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 |
| | 4497 | 4497 | 4497 | 4497 | 4540 | 4540 | 4540 | 4540 | 4540 | 4624 | 4624 | 4652 |
| | 1600 | 1600 | 1600 | 1600 | 1800 | 1800 | 1800 | 1800 | 1800 | 1800 | 1800 | 1800 |
| | 1950 | 1950 | 1950 | 1950 | 2050 | 2050 | 2050 | 2050 | 2050 | 2050 | 2050 | 2050 |
| | 6500 | 6550 | 6650 | 6750 | 7100 | 7200 | 7250 | 7350 | 7500 | 7600 | 7750 | 7800 |
| | 6970 | 7000 | 7150 | 7250 | 7800 | 7900 | 7950 | 8100 | 8250 | 8350 | 8575 | 8600 |

Parameters of TWSF-FW1 (R134a) flooded-type water source screw heat pump unit

| Model | | TWSF-FW1 | 0120.1 | 0140.1 | 0155.1 | 0180.1 | 0210.1 | 0230.1 | 0250.1 | 0270.1 | |
|---|-------------------------------|-------------------|--------|--------|--------|--------|--------|--------|--------|--------|--|
| Cooling capacity | Ton | | 123 | 139 | 150 | 176 | 211 | 227 | 250 | 268 | |
| | 10 ⁴ kcal/h | | 37 | 42 | 45 | 53 | 64 | 69 | 75 | 81 | |
| | kW | | 434 | 490 | 527 | 620 | 741 | 799 | 878 | 941 | |
| Heating capacity | 10 ⁴ kcal/h | | 39 | 44 | 47 | 55 | 66 | 71 | 78 | 84 | |
| | kW | | 448 | 506 | 544 | 643 | 769 | 828 | 908 | 976 | |
| Cooling power input | kW | | 65 | 74 | 79 | 93 | 110 | 118 | 130 | 139 | |
| Heating power input | kW | | 86 | 97 | 104 | 124 | 147 | 158 | 173 | 187 | |
| Cooling efficiency | kW/Ton | | 0.527 | 0.531 | 0.527 | 0.527 | 0.522 | 0.519 | 0.521 | 0.519 | |
| Cooling EER | W/W | | 6.68 | 6.62 | 6.67 | 6.67 | 6.74 | 6.77 | 6.75 | 6.77 | |
| Heating COP | W/W | | 5.21 | 5.22 | 5.23 | 5.19 | 5.23 | 5.24 | 5.25 | 5.22 | |
| Cooling current | A | | 139 | 150 | 165 | 188 | 205 | 216 | 240 | 250 | |
| Heating current | A | | 165 | 181 | 208 | 232 | 252 | 258 | 300 | 317 | |
| Starting current | A | | 414 | 615 | 683 | 845 | 845 | 845 | 965 | 965 | |
| Compressor quantity | Set | | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | |
| Cold and hot water-side heat ex-changer | Design pressure on water side | Mpa | 1.0 | | | | | | | | |
| | Water flow | m ³ /h | 75 | 84 | 91 | 107 | 127 | 137 | 151 | 162 | |
| | Water pressure drop | kPa | 65 | 70 | 67 | 67 | 83 | 82 | 85 | 90 | |
| | Piping DN | mm | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | |
| Underground water-side heat ex-changer | Design pressure on water side | Mpa | 1.0 | | | | | | | | |
| | Water flow | m ³ /h | 39 | 44 | 47 | 56 | 67 | 72 | 79 | 84 | |
| | Water pressure drop | kPa | 30 | 26 | 26 | 28 | 28 | 27 | 28 | 26 | |
| | Piping DN | mm | 150 | 150 | 150 | 150 | 200 | 200 | 200 | 200 | |
| Dimensions | Length | mm | 3122 | 3122 | 3122 | 3122 | 3144 | 3144 | 3144 | 3144 | |
| | Width | mm | 1500 | 1500 | 1500 | 1500 | 1550 | 1550 | 1550 | 1550 | |
| | Height | mm | 1800 | 1800 | 1800 | 1800 | 1850 | 1850 | 1850 | 1850 | |
| Shipping weight | kg | | 2780 | 3230 | 3280 | 3380 | 3830 | 3880 | 4050 | 4200 | |
| Operating weight | kg | | 2980 | 3450 | 3520 | 3650 | 4150 | 4200 | 4400 | 4560 | |

★ Note:

1. The above data is based on the following operating conditions: cooling mode: inlet underground water temperature: 18°C; refrigerant water outlet temperature: 7°C; heating mode: inlet underground water temperature: 15°C; hot water outlet temperature: 45°C;
The maximum hot water outlet temperature in heating mode is 65°C. If the temperature goes beyond 60°C, please contact TICA factory.
2. If the unit is required to operate where groundwater temperature difference is significant, please contact TICA factory.
3. For technical parameters under non-standard operating conditions, please contact branches of TICA.
4. The maximum startup current listed in the table is the current under Y-Δ startup mode.
5. Power supply: 380V 3N-50Hz; allowable voltage fluctuation: ±10%.
6. Standard water chamber pressure: 1.0 MPa; optional water chamber pressure: 1.6 MPa, 2.0 MPa.
7. Specification parameters are subject to change without prior notice, due to product improvement.



| | | | | | | | | | | | | |
|--|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|
| | 0285.2 | 0305.2 | 0330.2 | 0355.2 | 0375.2 | 0400.2 | 0420.2 | 0440.2 | 0465.2 | 0495.2 | 0520.2 | 0540.2 |
| | 288 | 301 | 322 | 352 | 375 | 400 | 417 | 441 | 465 | 495 | 517 | 537 |
| | 87 | 91 | 97 | 106 | 113 | 121 | 126 | 133 | 141 | 150 | 156 | 162 |
| | 1012 | 1057 | 1133 | 1237 | 1317 | 1406 | 1465 | 1552 | 1635 | 1739 | 1818 | 1888 |
| | 90 | 94 | 101 | 110 | 118 | 126 | 131 | 139 | 146 | 155 | 163 | 169 |
| | 1047 | 1094 | 1174 | 1285 | 1372 | 1464 | 1525 | 1614 | 1700 | 1804 | 1891 | 1965 |
| | 152 | 159 | 169 | 184 | 196 | 209 | 217 | 229 | 242 | 256 | 268 | 278 |
| | 200 | 209 | 224 | 246 | 262 | 279 | 291 | 307 | 323 | 343 | 361 | 376 |
| | 0.528 | 0.529 | 0.524 | 0.523 | 0.523 | 0.523 | 0.521 | 0.519 | 0.520 | 0.518 | 0.518 | 0.518 |
| | 6.66 | 6.65 | 6.70 | 6.72 | 6.72 | 6.73 | 6.75 | 6.78 | 6.76 | 6.79 | 6.78 | 6.79 |
| | 5.24 | 5.23 | 5.24 | 5.22 | 5.24 | 5.25 | 5.24 | 5.26 | 5.26 | 5.26 | 5.24 | 5.23 |
| | 300 | 315 | 330 | 355 | 377 | 395 | 410 | 430 | 455 | 489 | 500 | 510 |
| | 359 | 385 | 406 | 430 | 454 | 480 | 502 | 522 | 561 | 618 | 636 | 658 |
| | 1004 | 1072 | 1124 | 1286 | 1318 | 1318 | 1318 | 1318 | 1441 | 1561 | 1436 | 1436 |
| | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 |
| | 1.0 | | | | | | | | | | | |
| | 174 | 182 | 195 | 213 | 227 | 242 | 252 | 267 | 281 | 299 | 313 | 325 |
| | 71 | 86 | 77 | 87 | 70 | 70 | 77 | 62 | 71 | 74 | 73 | 72 |
| | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 |
| | 1.0 | | | | | | | | | | | |
| | 91 | 95 | 102 | 111 | 118 | 126 | 132 | 139 | 147 | 156 | 163 | 169 |
| | 25 | 26 | 25 | 28 | 25 | 25 | 28 | 27 | 28 | 28 | 28 | 30 |
| | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 |
| | 4497 | 4497 | 4497 | 4497 | 4567 | 4567 | 4567 | 4567 | 4567 | 4672 | 4672 | 4672 |
| | 1600 | 1600 | 1600 | 1600 | 1800 | 1800 | 1800 | 1800 | 1800 | 1800 | 1800 | 1800 |
| | 1950 | 1950 | 1950 | 1950 | 2050 | 2050 | 2050 | 2050 | 2050 | 2050 | 2050 | 2050 |
| | 6560 | 6610 | 6710 | 6810 | 7160 | 7260 | 7310 | 7410 | 7560 | 7660 | 7810 | 7860 |
| | 7100 | 7150 | 7250 | 7350 | 7950 | 8050 | 8100 | 8200 | 8400 | 8500 | 8700 | 8750 |

Parameters of TWSF-FG1 (R134a) flooded-type water source screw heat pump unit

| Model | | TWSF-FG1 | 0120.1 | 0140.1 | 0155.1 | 0180.1 | 0210.1 | 0230.1 | 0250.1 | 0270.1 | |
|--|-------------------------------|-------------------|--------|--------|--------|--------|--------|--------|--------|--------|--|
| Cooling capacity | Ton | | 122 | 138 | 148 | 175 | 209 | 225 | 247 | 265 | |
| | 10 ⁴ kcal/h | | 37 | 42 | 45 | 53 | 63 | 68 | 75 | 80 | |
| | kW | | 429 | 485 | 521 | 614 | 734 | 791 | 869 | 932 | |
| Heating capacity | 10 ⁴ kcal/h | | 38 | 43 | 46 | 55 | 65 | 70 | 77 | 83 | |
| | kW | | 442 | 500 | 536 | 635 | 760 | 818 | 896 | 963 | |
| Cooling power input | kW | | 67 | 75 | 81 | 96 | 112 | 121 | 133 | 142 | |
| Heating power input | kW | | 86 | 97 | 104 | 124 | 147 | 158 | 172 | 186 | |
| Cooling efficiency | kW/Ton | | 0.549 | 0.544 | 0.547 | 0.550 | 0.537 | 0.538 | 0.538 | 0.536 | |
| Cooling EER | W/W | | 6.40 | 6.47 | 6.43 | 6.40 | 6.55 | 6.54 | 6.53 | 6.56 | |
| Heating COP | W/W | | 5.14 | 5.15 | 5.15 | 5.12 | 5.17 | 5.18 | 5.21 | 5.18 | |
| Cooling current | A | | 142 | 152 | 167 | 190 | 208 | 219 | 244 | 254 | |
| Heating current | A | | 165 | 181 | 208 | 234 | 252 | 258 | 299 | 316 | |
| Starting current | A | | 414 | 615 | 683 | 845 | 845 | 845 | 965 | 965 | |
| Compressor quantity | Set | | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | |
| Cold and hot water-side heat exchanger | Design pressure on water side | Mpa | 1.0 | | | | | | | | |
| | Water flow | m ³ /h | 74 | 83 | 90 | 106 | 126 | 136 | 150 | 160 | |
| | Water pressure drop | kPa | 65 | 71 | 65 | 65 | 80 | 81 | 84 | 88 | |
| | Piping DN | mm | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | |
| Underground water-side heat exchanger | Design pressure on water side | Mpa | 1.0 | | | | | | | | |
| | Water flow | m ³ /h | 85 | 96 | 104 | 122 | 145 | 157 | 172 | 185 | |
| | Water pressure drop | kPa | 63 | 79 | 79 | 85 | 66 | 78 | 85 | 70 | |
| | Piping DN | mm | 150 | 150 | 150 | 150 | 200 | 200 | 200 | 200 | |
| Dimensions | Length | mm | 3122 | 3122 | 3122 | 3122 | 3144 | 3144 | 3144 | 3144 | |
| | Width | mm | 1500 | 1500 | 1500 | 1500 | 1550 | 1550 | 1550 | 1550 | |
| | Height | mm | 1800 | 1800 | 1800 | 1800 | 1850 | 1850 | 1850 | 1850 | |
| Shipping weight | kg | | 2780 | 3230 | 3280 | 3380 | 3830 | 3880 | 4050 | 4200 | |
| Operating weight | kg | | 3000 | 3450 | 3520 | 3650 | 4150 | 4250 | 4400 | 4560 | |

★ Note:

1. The above data is based on the following operating conditions: cooling mode: inlet geothermal water temperature: 25°C; refrigerant water outlet temperature: 7°C; heating mode: inlet geothermal water temperature: 10°C; hot water outlet temperature: 45°C.
The maximum hot water outlet temperature in heating mode is 65°C. If the temperature goes beyond 60°C, please contact TICA factory.
2. When the outlet geothermal water temperature is lower than 3°C, glycol solution needs to be added. Refer to Recommended Glycol Solution Concentration for details.
3. For technical parameters under non-standard operating conditions, please contact branches of TICA.
4. The maximum startup current listed in the table is the current under Y-Δ startup mode.
5. Power supply: 380V 3N-50Hz; allowable voltage fluctuation: ±10%.
6. Standard water chamber pressure: 1.0 MPa; optional water chamber pressure: 1.6 MPa, 2.0 MPa.
7. Specification parameters are subject to change without prior notice, due to product improvement.



| | | | | | | | | | | | | |
|--|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|
| | 0285.2 | 0305.2 | 0330.2 | 0355.2 | 0375.2 | 0400.2 | 0420.2 | 0440.2 | 0465.2 | 0495.2 | 0520.2 | 0540.2 |
| | 285 | 297 | 319 | 348 | 371 | 395 | 412 | 437 | 460 | 489 | 511 | 531 |
| | 86 | 90 | 96 | 105 | 112 | 120 | 125 | 132 | 139 | 148 | 155 | 160 |
| | 1001 | 1046 | 1121 | 1224 | 1303 | 1390 | 1449 | 1535 | 1617 | 1719 | 1797 | 1866 |
| | 88 | 92 | 99 | 108 | 116 | 123 | 128 | 136 | 143 | 152 | 159 | 165 |
| | 1025 | 1071 | 1150 | 1259 | 1344 | 1435 | 1494 | 1581 | 1664 | 1766 | 1850 | 1923 |
| | 155 | 162 | 172 | 188 | 200 | 213 | 222 | 234 | 247 | 263 | 275 | 285 |
| | 199 | 208 | 223 | 244 | 261 | 278 | 289 | 305 | 322 | 341 | 359 | 374 |
| | 0.544 | 0.545 | 0.539 | 0.540 | 0.540 | 0.539 | 0.539 | 0.536 | 0.537 | 0.538 | 0.538 | 0.537 |
| | 6.46 | 6.46 | 6.52 | 6.51 | 6.52 | 6.53 | 6.53 | 6.56 | 6.55 | 6.54 | 6.53 | 6.55 |
| | 5.15 | 5.15 | 5.16 | 5.16 | 5.15 | 5.16 | 5.17 | 5.18 | 5.17 | 5.18 | 5.15 | 5.14 |
| | 304 | 319 | 334 | 360 | 382 | 400 | 416 | 435 | 461 | 498 | 509 | 519 |
| | 358 | 384 | 405 | 428 | 453 | 479 | 500 | 502 | 549 | 607 | 622 | 628 |
| | 1004 | 1072 | 1124 | 1286 | 1318 | 1318 | 1318 | 1318 | 1441 | 1561 | 1436 | 1436 |
| | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 |
| | 1.0 | | | | | | | | | | | |
| | 172 | 180 | 193 | 211 | 224 | 239 | 249 | 264 | 278 | 296 | 309 | 321 |
| | 69 | 83 | 74 | 85 | 67 | 67 | 74 | 60 | 69 | 72 | 70 | 69 |
| | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 |
| | 1.0 | | | | | | | | | | | |
| | 199 | 208 | 222 | 243 | 259 | 276 | 287 | 304 | 321 | 341 | 357 | 370 |
| | 68 | 84 | 83 | 87 | 57 | 56 | 85 | 59 | 64 | 68 | 66 | 68 |
| | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 |
| | 4497 | 4497 | 4497 | 4497 | 4567 | 4567 | 4567 | 4567 | 4567 | 4672 | 4672 | 4672 |
| | 1600 | 1600 | 1600 | 1600 | 1800 | 1800 | 1800 | 1800 | 1800 | 1800 | 1800 | 1800 |
| | 1950 | 1950 | 1950 | 1950 | 2050 | 2050 | 2050 | 2050 | 2050 | 2050 | 2050 | 2050 |
| | 6560 | 6610 | 6710 | 6810 | 7160 | 7260 | 7310 | 7410 | 7560 | 7660 | 7810 | 7860 |
| | 7100 | 7150 | 7250 | 7350 | 7900 | 8050 | 8100 | 8250 | 8400 | 8500 | 8700 | 8750 |

Parameters of TWSF-FC1 (R134a) flooded-type water-cooled screw chiller Super high-efficiency series

| Model | | TWSF-FC1 | 0430.1 | 0450.1 | 0470.1 | 0850.2 | 0900.2 | 0940.2 |
|---------------------|-------------------------------|-------------------------------|--------|--------|--------|--------|--------|--------|
| Cooling capacity | Ton | | 429 | 450 | 469 | 854 | 895 | 933 |
| | 10 ⁴ kcal/h | | 130 | 136 | 142 | 258 | 271 | 282 |
| | kW | | 1509 | 1581 | 1648 | 3002 | 3148 | 3279 |
| Power input | kW | | 239 | 250 | 259 | 475 | 496 | 516 |
| Efficiency | kW/Ton | | 0.557 | 0.556 | 0.553 | 0.556 | 0.554 | 0.553 |
| COP | W/W | | 6.31 | 6.32 | 6.36 | 6.32 | 6.35 | 6.35 |
| Running current | A | | 404 | 421 | 438 | 803 | 835 | 871 |
| Starting current | A | | 1033 | 1033 | 1033 | 1668 | 1668 | 1668 |
| Compressor quantity | Set | | 1 | 1 | 1 | 2 | 2 | 2 |
| Power supply | | 380 V 3N-50 Hz | | | | | | |
| Refrigerant | | R134a | | | | | | |
| Energy control | | Stepless regulation of energy | | | | | | |
| Evaporator | Design pressure on water side | Mpa | 1.0 | | | | | |
| | Water flow | m ³ /h | 260 | 272 | 284 | 516 | 541 | 564 |
| | Water pressure drop | kPa | 60 | 45 | 40 | 60 | 60 | 70 |
| | Piping DN | mm | 200 | 200 | 200 | 250 | 250 | 250 |
| Condenser | Design pressure on water side | Mpa | 1.0 | | | | | |
| | Water flow | m ³ /h | 301 | 315 | 328 | 598 | 627 | 653 |
| | Water pressure drop | kPa | 40 | 45 | 40 | 80 | 80 | 70 |
| | Piping DN | mm | 250 | 250 | 250 | 300 | 300 | 300 |
| Dimensions | Length | mm | 4800 | 4800 | 4800 | 6700 | 6700 | 6700 |
| | Width | mm | 2260 | 2260 | 2260 | 2700 | 2700 | 2700 |
| | Height | mm | 2600 | 2600 | 2600 | 2750 | 2750 | 2750 |
| Shipping weight | | kg | 7800 | 8300 | 8800 | 13000 | 14000 | 15000 |
| Operating weight | | kg | 8970 | 9500 | 10100 | 14950 | 16000 | 17000 |

★ Note:

1. The parameters under above operating conditions are as follows: chilled water outlet temperature 7°C, chilled water inlet temperature 30°C.
2. For technical parameters under non-standard operating conditions, please contact branches of TICA.
3. The maximum startup current listed in the table is the current under Y-△ startup mode.
4. Power supply: 380V 3N-50Hz; allowable voltage fluctuation: ±10%.
5. Standard water chamber pressure: 1.0 MPa; optional water chamber pressure: 1.6 MPa, 2.0 MPa.
6. Specification parameters are subject to change without prior notice, due to product improvement.

System

- ◆ Full heat recovery technology

The unit can effectively recycle the condensation heat to meet the usage requirement of warm water supply for domestic use of clients.

- ◆ Flow changing technology

Inverter water pump is equipped to reduce system pump power consumption, but to ensure stable operation of the system, please note that:

1. The chilled water flow ranges from 40% to 110% of the nominal flow.
2. The rate of change of water flow should not exceed 30% per minute, and the recommended rate of change of water flow is 10% per minute.
3. The water flow is recommended to fall within 0.8-3.0m/s. When the water flows too slowly, the heat transfer efficiency may be affected and the unit's efficiency may be compromised; when the water flows too quickly, it may lead to excessive voltage drop, thereby adversely impacting the unit's service life.
4. Cooling water flow should not exceed 110% of the nominal value. Variable chilled water flow design is recommended.

- ◆ Perennial cooling

Perennial cooling unit can be provided according to on-site situation.

Electric control

- ◆ Circuit breaker

Depending on customer requirements, circuit breakers may be added to further effectively protect the unit.

- ◆ Solid-state soft start

Depending on customer requirements, solid-state soft start may be equipped to lower the startup current of the unit and to reduce the impact on the power grid.

Container

- ◆ Water pipe connection mode: standard clamp connection, optional flange connection

- ◆ Water side pressure: standard unit container pressure is 1.0MPa (1.6MPa and 2.0MPa optional)

- ◆ Water pipe connection direction: Depending on the installation site conditions, the pipe direction may be varied

Others

- ◆ Shock absorbing device: The unit comes with 4 pieces of 30mm chloroprene rubber shock-absorbing cushions. Spring shock-absorbing cushions may be provided depending on customer's requirements.

- ◆ Bottom channel steel: Bottom channel steel may be provided depending on customer's requirements.

- ◆ Insulation: A standard unit is insulated with 20mm rubber and plastic insulation material. A 40mm thick layer of insulation may be provided upon request.


- ◆ Package: A standard unit is packed with heat shrinkable membrane. It may be also provided with a wooden box if required.

Note: For any additional requirements, please contact the local dealer of TICA.

Unit options – full heat recovery (for FW, FG heat pump units only)

The condensation heat recovery is to use heat exchange device to recover the waste heat from the condenser. Specifically, hot refrigerant exiting from the compressor will first enter the heat recovery device where it could exchange heat with running water to produce domestic or industrial hot water and will then enter the condenser to exchange heat.

The following figure shows the diagram of heat recovery process of domestic hot water.

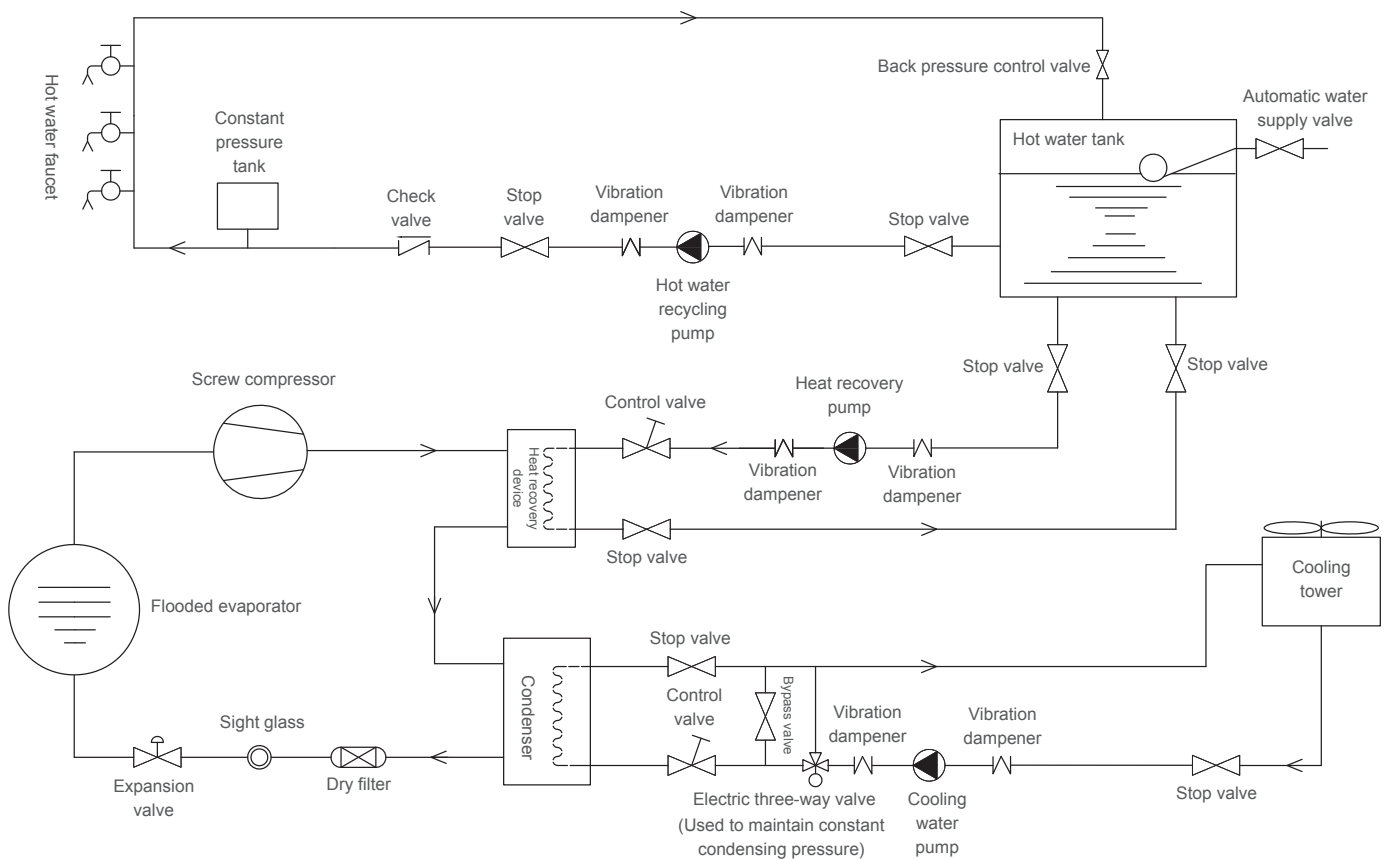

Full heat recovery parameters of the water-cooled flooded screw chiller (heat pump) (optional)

| Model | Outlet water temperature: 45°C | | Outlet water temperature: 50°C | | Outlet water temperature: 55°C | | Connector size DN |
|----------------|--------------------------------|-----------------------|--------------------------------|-----------------------|--------------------------------|-----------------------|-------------------|
| | Heat recovery capacity (kW) | Hot water flow (m³/h) | Heat recovery capacity (kW) | Hot water flow (m³/h) | Heat recovery capacity (kW) | Hot water flow (m³/h) | |
| TWSF0120.1FW1A | 448 | 77 | 434 | 75 | 420 | 72 | 150 |
| TWSF0140.1FW1A | 506 | 87 | 489 | 84 | 470 | 81 | 150 |
| TWSF0155.1FW1A | 544 | 94 | 533 | 92 | 512 | 88 | 150 |
| TWSF0180.1FW1A | 643 | 111 | 622 | 107 | 600 | 103 | 150 |
| TWSF0210.1FW1A | 769 | 132 | 743 | 128 | 718 | 124 | 200 |
| TWSF0230.1FW1A | 828 | 143 | 800 | 138 | 773 | 133 | 200 |
| TWSF0250.1FW1A | 908 | 156 | 806 | 139 | 778 | 134 | 200 |
| TWSF0270.1FW1A | 976 | 168 | 938 | 162 | 907 | 156 | 200 |
| TWSF0285.2FW1A | 1047 | 180 | 1012 | 174 | 973 | 168 | 200 |
| TWSF0305.2FW1A | 1094 | 188 | 1054 | 182 | 1013 | 175 | 200 |
| TWSF0330.2FW1A | 1174 | 202 | 1150 | 198 | 1105 | 190 | 200 |
| TWSF0355.2FW1A | 1285 | 221 | 1250 | 215 | 1204 | 207 | 200 |
| TWSF0375.2FW1A | 1372 | 236 | 1326 | 228 | 1281 | 221 | 200 |
| TWSF0400.2FW1A | 1464 | 252 | 1415 | 244 | 1367 | 235 | 200 |
| TWSF0420.2FW1A | 1525 | 263 | 1474 | 254 | 1423 | 245 | 200 |
| TWSF0440.2FW1A | 1614 | 278 | 1560 | 269 | 1506 | 259 | 200 |
| TWSF0465.2FW1A | 1700 | 293 | 1616 | 278 | 1560 | 269 | 200 |
| TWSF0495.2FW1A | 1804 | 311 | 1745 | 301 | 1686 | 290 | 200 |
| TWSF0520.2FW1A | 1891 | 326 | 1829 | 315 | 1768 | 305 | 200 |
| TWSF0540.2FW1A | 1965 | 338 | 1900 | 327 | 1837 | 316 | 200 |
| TWSF0120.1FG1A | 442 | 76 | 427 | 74 | 414 | 71 | 150 |
| TWSF0140.1FG1A | 500 | 86 | 481 | 83 | 464 | 80 | 150 |
| TWSF0155.1FG1A | 536 | 92 | 516 | 89 | 496 | 85 | 150 |
| TWSF0180.1FG1A | 635 | 109 | 614 | 106 | 594 | 102 | 150 |
| TWSF0210.1FG1A | 760 | 131 | 735 | 127 | 710 | 122 | 200 |
| TWSF0230.1FG1A | 818 | 141 | 791 | 136 | 764 | 132 | 200 |
| TWSF0250.1FG1A | 896 | 154 | 866 | 149 | 836 | 144 | 200 |
| TWSF0270.1FG1A | 963 | 166 | 932 | 161 | 902 | 155 | 200 |
| TWSF0285.2FG1A | 1025 | 177 | 986 | 170 | 951 | 164 | 200 |
| TWSF0305.2FG1A | 1071 | 184 | 1031 | 178 | 992 | 171 | 200 |
| TWSF0330.2FG1A | 1150 | 198 | 1107 | 191 | 1064 | 183 | 200 |
| TWSF0355.2FG1A | 1259 | 217 | 1215 | 209 | 1172 | 202 | 200 |
| TWSF0375.2FG1A | 1344 | 232 | 1300 | 224 | 1257 | 217 | 200 |
| TWSF0400.2FG1A | 1435 | 247 | 1388 | 239 | 1341 | 231 | 200 |
| TWSF0420.2FG1A | 1494 | 257 | 1445 | 249 | 1396 | 240 | 200 |
| TWSF0440.2FG1A | 1581 | 272 | 1529 | 263 | 1477 | 254 | 200 |
| TWSF0465.2FG1A | 1664 | 287 | 1608 | 277 | 1554 | 268 | 200 |
| TWSF0495.2FG1A | 1766 | 304 | 1708 | 294 | 1651 | 284 | 200 |
| TWSF0520.2FG1A | 1850 | 319 | 1791 | 308 | 1733 | 299 | 200 |
| TWSF0540.2FG1A | 1923 | 331 | 1862 | 321 | 1802 | 310 | 200 |



★ Note:

1. Please contact the factory for the dimensions of full heat recovery unit.

Water-cooled Flooded Screw Chiller (Heat Pump)

Unit Dimensions

—Single head high-efficiency series

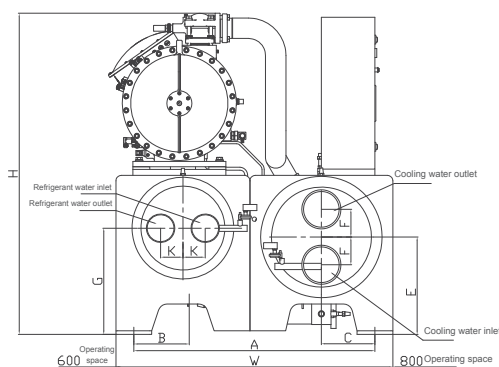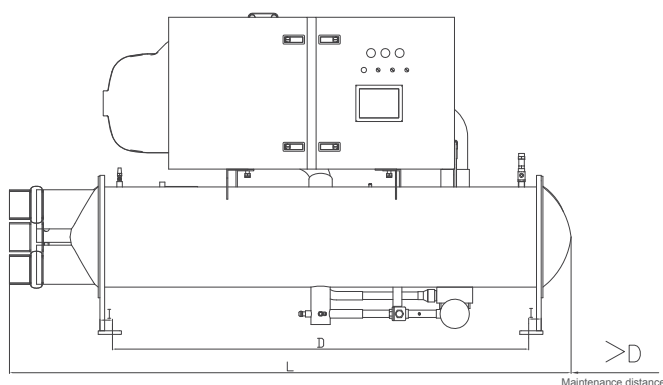


| Model (TWSF-FC1) | Evaporator water inlet/ outlet | Condenser water inlet/ outlet | A | B | C | D | E | F | G | L | W | H | K | I |
|---------------------|--------------------------------------|-------------------------------------|------|-----|-----|------|-----|-----|-----|------|------|------|-----|----|
| 0110.1 | DN150 | DN150 | 1300 | 275 | 275 | 2330 | 495 | 125 | 595 | 3122 | 1500 | 1800 | 125 | 70 |
| 0135.1 | DN150 | DN150 | 1300 | 275 | 275 | 2330 | 495 | 125 | 595 | 3122 | 1500 | 1800 | 125 | |
| 0160.1 | DN150 | DN150 | 1300 | 275 | 275 | 2330 | 495 | 125 | 595 | 3122 | 1500 | 1800 | 125 | |
| 0175.1 | DN150 | DN150 | 1300 | 275 | 275 | 2330 | 495 | 125 | 595 | 3122 | 1500 | 1800 | 125 | |
| 0200.1 | DN150 | DN200 | 1350 | 275 | 300 | 2330 | 545 | 155 | 595 | 3144 | 1550 | 1850 | 125 | |
| 0220.1 | DN150 | DN200 | 1350 | 275 | 300 | 2330 | 545 | 155 | 595 | 3144 | 1550 | 1850 | 125 | |
| 0240.1 | DN150 | DN200 | 1350 | 275 | 300 | 2330 | 545 | 155 | 570 | 3144 | 1550 | 1850 | 130 | |
| 0265.1 | DN150 | DN200 | 1350 | 275 | 300 | 2330 | 545 | 155 | 570 | 3144 | 1550 | 1850 | 130 | |

| Model (TWSF-FW(G)1) | Evaporator water inlet/ outlet | Condenser water inlet/ outlet | A | B | C | D | E | F | G | L | W | H | K | I |
|------------------------|--------------------------------------|-------------------------------------|------|-----|-----|------|-----|-----|-----|------|------|------|-----|----|
| 0120.1 | DN150 | DN150 | 1300 | 275 | 275 | 2330 | 495 | 125 | 595 | 3122 | 1500 | 1800 | 125 | 70 |
| 0140.1 | DN150 | DN150 | 1300 | 275 | 275 | 2330 | 495 | 125 | 595 | 3122 | 1500 | 1800 | 125 | |
| 0155.1 | DN150 | DN150 | 1300 | 275 | 275 | 2330 | 495 | 125 | 595 | 3122 | 1500 | 1800 | 125 | |
| 0180.1 | DN150 | DN150 | 1300 | 275 | 275 | 2330 | 495 | 125 | 595 | 3122 | 1500 | 1800 | 125 | |
| 0210.1 | DN150 | DN200 | 1350 | 275 | 300 | 2330 | 545 | 155 | 595 | 3144 | 1550 | 1850 | 125 | |
| 0230.1 | DN150 | DN200 | 1350 | 275 | 300 | 2330 | 545 | 155 | 595 | 3144 | 1550 | 1850 | 125 | |
| 0250.1 | DN150 | DN200 | 1350 | 275 | 300 | 2330 | 545 | 155 | 570 | 3144 | 1550 | 1850 | 130 | |
| 0270.1 | DN150 | DN200 | 1350 | 275 | 300 | 2330 | 545 | 155 | 570 | 3144 | 1550 | 1850 | 130 | |


★ Note:

1. The water inlet and outlet pipes of evaporator and condenser must be supported to avoid applying any external force to the unit.
2. The size of the equipment room area can guarantee repair and maintenance of the evaporator and condenser.

—Dual head high-efficiency series

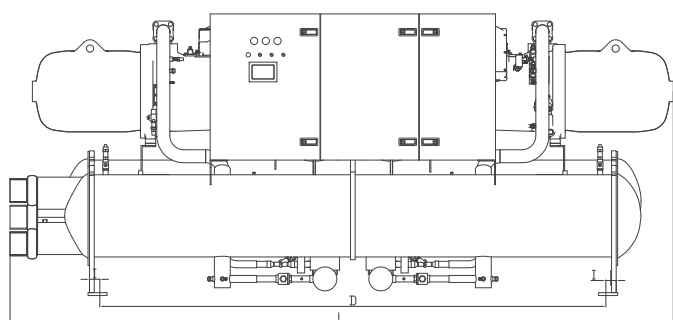

Maintenance distance

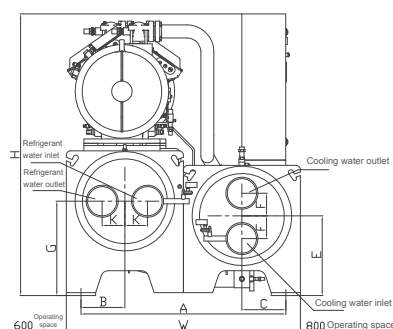


| Model (TWSF-FC1) | Evaporator water inlet/ outlet | Condenser water inlet/ outlet | A | B | C | D | E | F | G | L | W | H | K | I |
|---------------------|--------------------------------------|-------------------------------------|------|-----|-----|------|-----|-----|-----|------|------|------|-----|----|
| 0280.2 | DN200 | DN200 | 1400 | 300 | 300 | 3460 | 545 | 155 | 645 | 4497 | 1600 | 1950 | 155 | 70 |
| 0300.2 | DN200 | DN200 | 1400 | 300 | 300 | 3460 | 545 | 155 | 645 | 4497 | 1600 | 1950 | 155 | |
| 0325.2 | DN200 | DN200 | 1400 | 300 | 300 | 3460 | 545 | 155 | 645 | 4497 | 1600 | 1950 | 155 | |
| 0350.2 | DN200 | DN200 | 1400 | 300 | 300 | 3460 | 545 | 155 | 645 | 4497 | 1600 | 1950 | 155 | |
| 0370.2 | DN200 | DN200 | 1600 | 350 | 350 | 3460 | 595 | 180 | 695 | 4540 | 1800 | 2050 | 180 | |
| 0390.2 | DN200 | DN200 | 1600 | 350 | 350 | 3460 | 595 | 180 | 695 | 4540 | 1800 | 2050 | 180 | |
| 0410.2 | DN200 | DN200 | 1600 | 350 | 350 | 3460 | 595 | 180 | 695 | 4540 | 1800 | 2050 | 180 | |
| 0430.2 | DN200 | DN200 | 1600 | 350 | 350 | 3460 | 595 | 180 | 695 | 4540 | 1800 | 2050 | 180 | |
| 0450.2 | DN200 | DN200 | 1600 | 350 | 350 | 3460 | 595 | 180 | 695 | 4540 | 1800 | 2050 | 180 | |
| 0465.2 | DN200 | DN200 | 1600 | 350 | 350 | 3460 | 595 | 180 | 695 | 4624 | 1800 | 2050 | 180 | |
| 0495.2 | DN200 | DN200 | 1600 | 350 | 350 | 3460 | 595 | 180 | 695 | 4624 | 1800 | 2050 | 180 | |
| 0510.2 | DN200 | DN200 | 1600 | 350 | 350 | 3460 | 595 | 180 | 695 | 4652 | 1800 | 2050 | 180 | |

| Model (TWSF-FW(G)1) | Evaporator water inlet/ outlet | Condenser water inlet/ outlet | A | B | C | D | E | F | G | L | W | H | K | I |
|------------------------|--------------------------------------|-------------------------------------|------|-----|-----|------|-----|-----|-----|------|------|------|-----|----|
| 0285.2 | DN200 | DN200 | 1400 | 300 | 300 | 3460 | 545 | 155 | 645 | 4497 | 1600 | 1950 | 155 | 70 |
| 0305.2 | DN200 | DN200 | 1400 | 300 | 300 | 3460 | 545 | 155 | 645 | 4497 | 1600 | 1950 | 155 | |
| 0330.2 | DN200 | DN200 | 1400 | 300 | 300 | 3460 | 545 | 155 | 645 | 4497 | 1600 | 1950 | 155 | |
| 0355.2 | DN200 | DN200 | 1400 | 300 | 300 | 3460 | 545 | 155 | 645 | 4497 | 1600 | 1950 | 155 | |
| 0375.2 | DN200 | DN200 | 1600 | 350 | 350 | 3460 | 595 | 180 | 695 | 4567 | 1800 | 2050 | 180 | |
| 0400.2 | DN200 | DN200 | 1600 | 350 | 350 | 3460 | 595 | 180 | 695 | 4567 | 1800 | 2050 | 180 | |
| 0420.2 | DN200 | DN200 | 1600 | 350 | 350 | 3460 | 595 | 180 | 695 | 4567 | 1800 | 2050 | 180 | |
| 0440.2 | DN200 | DN200 | 1600 | 350 | 350 | 3460 | 595 | 180 | 695 | 4567 | 1800 | 2050 | 180 | |
| 0465.2 | DN200 | DN200 | 1600 | 350 | 350 | 3460 | 595 | 180 | 695 | 4567 | 1800 | 2050 | 180 | |
| 0495.2 | DN200 | DN200 | 1600 | 350 | 350 | 3460 | 595 | 180 | 695 | 4672 | 1800 | 2050 | 180 | |
| 0520.2 | DN200 | DN200 | 1600 | 350 | 350 | 3460 | 595 | 180 | 695 | 4672 | 1800 | 2050 | 180 | |
| 0540.2 | DN200 | DN200 | 1600 | 350 | 350 | 3460 | 595 | 180 | 695 | 4672 | 1800 | 2050 | 180 | |

★ Note:


1. The water inlet and outlet pipes of evaporator and condenser must be supported to avoid applying any external force to the unit.
2. The size of the equipment room area can guarantee repair and maintenance of the evaporator and condenser.

—Single head super high-efficiency series

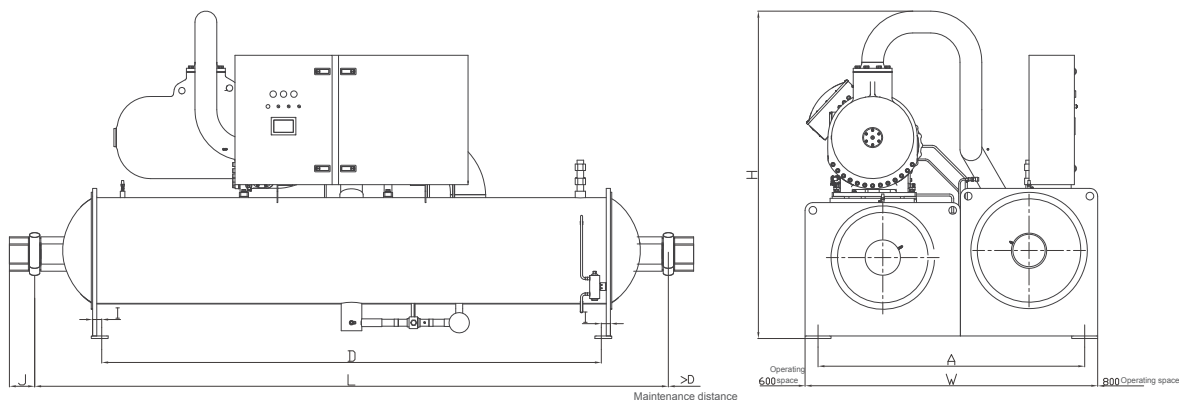

| Model (TWSF-FC1) | Evaporator water inlet/ outlet | Condenser water inlet/ outlet | A | D | L | W | H | I | J |
|---------------------|--------------------------------------|-------------------------------------|------|------|------|------|------|----|-----|
| 0430.1 | DN200 | DN250 | 2060 | 3460 | 4800 | 2260 | 2600 | 70 | 200 |
| 0450.1 | DN200 | DN250 | 2060 | 3460 | 4800 | 2260 | 2600 | | |
| 0470.1 | DN200 | DN250 | 2060 | 3460 | 4800 | 2260 | 2600 | | |

—Dual head super high-efficiency series

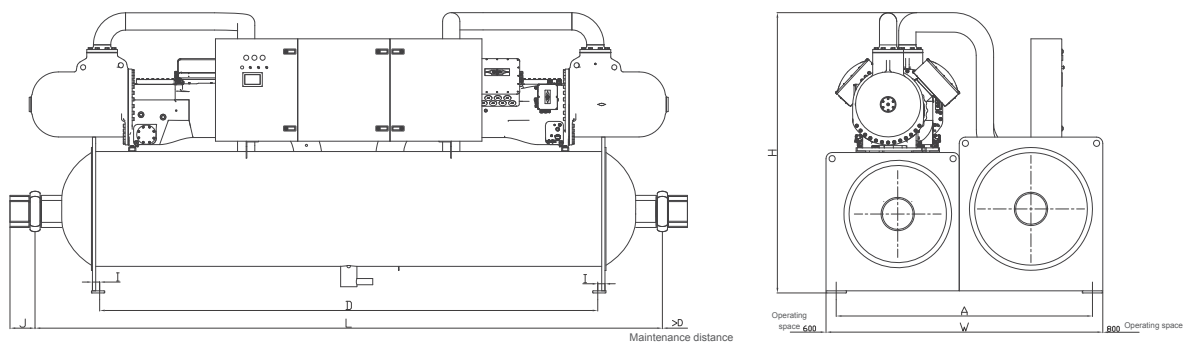

| Model (TWSF-FC1) | Evaporator water inlet/ outlet | Condenser water inlet/ outlet | A | D | L | W | H | I | J |
|---------------------|--------------------------------------|-------------------------------------|------|------|------|------|------|----|-----|
| 0850.2 | DN250 | DN300 | 2500 | 5360 | 6700 | 2700 | 2750 | 70 | 200 |
| 0900.2 | DN250 | DN300 | 2500 | 5360 | 6700 | 2700 | 2750 | | |
| 0940.2 | DN250 | DN300 | 2500 | 5360 | 6700 | 2700 | 2750 | | |

★ Note:

1. The water inlet and outlet pipes of evaporator and condenser must be supported to avoid applying any external force to the unit.
2. The size of the equipment room area can guarantee repair and maintenance of the evaporator and condenser.

Table 1 Unit safety devices

| Safety device | Possible cause |
|---|--|
| High pressure protection | 1. The fluorine system valve is not open |
| | 2. Insufficient cooling water flow |
| | 3. Dirt deposits on the condenser |
| | 4. Non-condensable gas exists in the system |
| Freezing protection | 1. Chilled water temperature is too low |
| | 2. Set temperature is too low |
| Discharge gas temperature protection | 1. Low refrigerant level due to leak |
| | 2. Solenoid valve closed due to a fault |
| | 3. Improper adjustment of the discharge superheat degree |
| Motor overheat protection (compressor motor protection) | The same as high pressure protection |
| Low pressure protection | 1. The liquid supply solenoid valve fails or the dry filter is blocked |
| | 2. The expansion valve is improperly adjusted |
| | 3. Insufficient chilled water flow |
| | 4. Evaporator fouls |
| Phase sequence protector | Power connection error |
| Over-current relay (compressor motor) | The same as high pressure protection |
| Safety valve | Refrigerant system exceeds the pressure |

Table 2 Recommended operating ranges of the unit

Water-cooled Screw Chiller

| Item | | Standard operating condition | Continuous operation area |
|-------------------|-------------------------------------|------------------------------|---------------------------|
| Cooling condition | Cooling water inlet temperature °C | 30 | 16 - 40 |
| | Chilled water outlet temperature °C | 7 | 4 - 15 |

Water Source Screw Heat Pump Unit

| Item | | Standard operating conditions (TWSF-W/G) | Continuous operation area (TWSF-W/G) |
|-------------------|----------------------------------|--|--------------------------------------|
| Cooling condition | Condenser outlet temperature °C | 29/30 | 20 - 42 |
| | Evaporator outlet temperature °C | 7 | 4 - 16 |
| Heating condition | Condenser outlet temperature °C | 45 | 35 - 60 |
| | Evaporator outlet temperature °C | 7/5 | 4 - 16 |

Note: For operation under the extreme conditions, the user is advised to configure a three-way valve (used for the constant condensation pressure) for stepless regulation of the water flow.

Routine Maintenance

TICA recommends the user record the routine operating data of air-conditioning equipment and regularly carry out maintenance.

- Before using the unit for the first time, check the functioning of the air side equipment and other parts of the water system.
- (Recommended) Use the following service schedule to maintain the unit:

| | | | | | | | |
|---|--|---|------------|------------|------------|------------|---|
| Daily inspection | | 1. Check whether the unit generates any alarm | | | | | |
| | | 2. Check whether the air discharge and air suction pressures and oil pressure are normal | | | | | |
| | | 3. Check whether the oil level is normal (check through the oil sight glass to ensure proper amount of oil) | | | | | |
| | | 4. Check for any abnormal compressor noise | | | | | |
| | | 5. Check for odors inside the startup cabinet and control cabinet | | | | | |
| | | 6. Check whether the temperature sensor and temperature probe are securely fixed | | | | | |
| | | 7. Check for any appearance damage of the unit | | | | | |
| | | 8. Check whether the cooling tower, water pump, and valve function normally | | | | | |
| | | 9. Check the appearance of water pipes for damages and leakage | | | | | |
| Monthly inspection | | 1. Check the coil of compressor oil (the oil should be clear and clean; if the color turns dark brown or muddy, replace the oil; if the oil turns black, disassemble and inspect the compressor) | | | | | |
| | | 2. Check the color of the test paper in the sight glass of liquid supply pipe (yellow indicates that the refrigerant has excessive water content) | | | | | |
| | | 3. Check for leakage in the refrigerant loop (whether there is any greasy dirt or sound of leak) | | | | | |
| | | 4. Clean the startup cabinet and control cabinet | | | | | |
| | | 5. Check cleanliness of the water line filter, and clean the filter when necessary | | | | | |
| | | 6. Check the water quality, and send the water sample for laboratory analysis if possible (water quality should comply with the standard Code for Design of Industrial Recirculating Cooling Water Treatment or other relevant standards) | | | | | |
| Inspection Based on Service Life or Runtime | | 1 year | 2 years | 3 years | 4 years | 5 years | Exceptions |
| | | 1000 hours | 3000 hours | 5000 hours | 7000 hours | 9000 hours | |
| Compressor | Motor | | | | ☆ | | Insulation resistance is abnormal. |
| | Solenoid valve | ☆ | ☆ | ☆ | ☆ | ☆ | Insulation resistance is abnormal. |
| | Oil heater | ☆ | ☆ | ☆ | ☆ | ☆ | |
| | Compressor oil filter | ★ | ★ | ★ | ★ | ★ | Oil pressure alarm |
| | Lubricant | ★ | ★ | ★ | ★ | ★ | Discoloration or turbidity |
| | Refrigerant filter | ★ | ★ | ★ | ★ | ★ | |
| Heat exchanger | Evaporator and condenser | | ★ | ☆ | ★ | ☆ | Temperature difference for heat exchange exceeds 3°C |
| | Check the water inlet/outlet pressure difference (refer to the table of unit specifications) | ★ | ★ | ★ | ★ | ★ | Water pressure difference is too large or too small. Adjust the water flow until it meets the requirements. |
| Valves | Solenoid valve | ☆ | ☆ | ☆ | ☆ | ☆ | Cannot be opened or closed normally |
| | EXV | | | | | | Check the resistance and opening |
| | Float valve | ☆ | ☆ | ☆ | ☆ | ☆ | The valve cannot ensure normal liquid supply. |
| Electric | Fuse | ☆ | ☆ | ☆ | ☆ | ☆ | Disconnection |
| | Contactors | ☆ | ☆ | ☆ | ☆ | ☆ | Serious contact electrocorrosion or noise during running. |
| | Sensor | ☆ | ☆ | ☆ | ☆ | ☆ | Measured value still varies from the actual value even after calibration. |
| | High pressure switch | ☆ | ☆ | ☆ | ☆ | ☆ | Controller false alarm. |
| | Fastening wiring terminal | ★ | ★ | ★ | ★ | ★ | The contactor gets loose or can flexibly rotate when turning the connecting cable. |
| | Checking power supply | ★ | ★ | ★ | ★ | ★ | Rated voltage ±10%, phase-to-phase unbalance < 2%. |
| | Checking phase | ★ | ★ | ★ | ★ | ★ | No phase loss or reverse phase |

Notes:

- ★-----Required maintenance or replacement items; ☆----- Determine the maintenance items according to actual conditions.
- Daily and monthly inspections should be performed and recorded by the user.
- The replacement of consumable parts and materials is determined by the service life or operation duration of the unit. For units that operate all year around and those for the purpose of process, the operation duration should prevail; for units under normal operation and those for comfort, the service life should prevail.
After the initial 1000-hour operation of the unit, replace the lubricant, oil filter, and other filters in the refrigerant system.
After that, perform laboratory analysis on the refrigerant and oil every 2000 operating hours, to check whether the refrigerant or oil needs to be replaced.
Relevant sealing pad shall also be replaced when replacing the lubricant and filter.
- Consumable parts and materials include refrigerant, refrigerant oil, oil filter, dry filter element, dry filter screen, filter screen of electric cabinet, battery, water side sealing pad, etc.



EUROCON

Air Conditioning (PVT.) LTD.

EUROCON Airconditioning (Pvt) Ltd.

HEAD OFFICE

Suite # 309, 3rd Floor, KATI Building,
Near Brookes Round about, Korangi Industrial Area,
Karachi, Pakistan.
Tel (92-21) 351 101 20
Email info@eurocon.com.pk

